




CONSTRUCTION NOTES

- ALL WORKS WERE IN ACCORDANCE WITH, BUT NOT LIMITED TO, WATER SUPPLY CODE OF AUSTRALIA - WSA 03-2002-2.2 (SYDNEY WATER EDITION), PRESSURE SEWER SOLUTIONS Pty Ltd MASTERPLAN DRAWINGS & PITT TOWN WATER (P.T.W.) REQUIREMENTS.
- ALL EQUIPMENT, MATERIALS & ACCESSORIES USED IN THIS CONTRACT WERE NEW, SHALL CONFORM WITH THE APPROPRIATE CURRENT AUSTRALIAN STANDARDS & SHALL COMPLY WITH P.T.W. REQUIREMENTS.
- ALL SERVICES SHOWN WERE INDICATIVE ONLY. A CURRENT SERVICES SEARCH & SITE CHECK OF ALL EXISTING SERVICES WAS REQUIRED PRIOR TO COMMENCEMENT OF ANY WORKS. THE CONTRACTOR WAS TO DETERMINE LEVELS & LOCATIONS EXISTING SERVICES IN THE VICINITY OF THE CONSTRUCTION SITE AND ANY CONSTRUCTED STRUCTURES FOR PROPOSED SERVICES, SUCH AS DUCTING FOR WATER OR ELECTRICITY WITHIN THE SUBDIVISION. THE CONTRACTOR WAS TO ENSURE ALL SERVICES ARE LOCATED BY THE RELEVANT AUTHORITY PRIOR TO COMMENCEMENT OF WORKS.
- ALL RECYCLED WATER MAINS ARE LILAC (PN16).
- MAIN LAID GENERALLY 2.4m P.L. EXCEPT WHERE OTHERWISE SHOWN. MINIMUM PIPE COVER SHALL BE 600mm IN FOOTPATHS & 1000mm FOR ROAD CROSSINGS. MAXIMUM PIPE COVER SHALL BE 1500mm UNLESS SPECIFIED ON THE DESIGN PLANS OR APPROVAL IS OBTAINED FROM THE P.T.W. REPRESENTATIVE.
- MAINS CROSSING UNDER DRIVEWAYS (SEALED, PAVED OR DECORATIVE) SHALL BE CONDUCTED BY UNDER BORING ONLY.
- MAINS WITHIN 2m OF ELECTRICITY OR POWER POLES SHALL BE CONDUCTED BY BORING TECHNOLOGY (UNLESS AGREED TO BY P.T.W. REPRESENTATIVE).
- ALL MAINS LAID IN (TRAFFICABLE) CARRIAGEWAYS WERE BACKFILLED WITH 20:1 STABILISED SAND CEMENT TO SUBGRADE LEVEL.
- MARKER TAPE & TRACING WIRE INSTALLED TO P.T.W. REQUIREMENTS.
- DURING CONSTRUCTION, ALL OPEN ENDS OF PIPE WERE CAPPED OFF TO PREVENT ENTRY OF FOREIGN MATTER.
- ALL VALVES RESTRAINED IN ACCORDANCE WITH WAT-1207.
- THE CONTRACTOR SHALL PROVIDE P.T.W. WITH MINIMUM OF 7 DAYS NOTICE OF INTENT TO CONNECT NEW MAINS TO EXISTING INFRASTRUCTURE.
- UPON COMPLETION OF WORKS, ALL SURFACES WERE RESTORED AS CLOSE AS POSSIBLE, TO THE CONDITION THAT EXISTED PRIOR TO COMMENCEMENT OF WORK.
- BURIED FITTINGS WERE NOT TO BE BACKFILLED UNTIL W.A.C. DETAILS HAVE BEEN OBTAINED & APPROVAL FOR BACKFILLING GIVEN BY THE P.T.W. REPRESENTATIVE.
- THE MINIMUM NUMBER OF COMPACTION TESTS REQUIRED TO SATISFY THE WATER SUPPLY CODE OF AUSTRALIA ARE:
 TRAFFICABLE:
 PIPE EMBEDMENT ZONE: NIL TRENCH FILL ZONE: NIL ** REFER NOTE 8 **
 NON-TRAFFICABLE:
 PIPE EMBEDMENT ZONE: NI TRENCH FILL ZONE: 4 TESTS
- ALL MAINS FLUSHED WITH WATER TO REMOVE ANY DEBRIS PRIOR TO COMMISSIONING.
- ALL PROPERTY (MAIN TO METER) SERVICES WERE CONSTRUCTED TO SYDNEY WATER'S INSTALLATION REQUIREMENTS BY A LICENSED PLUMBER. THE WORKS WERE INSTALLED IN ACCORDANCE WITH THE CURRENT SYDNEY WATER PROPERTY (MAIN TO METER) SERVICE INSTALLATIONS TECHNICAL REQUIREMENTS, NSW CODE OF PRACTICE FOR PLUMBING & DRAINAGE AND AS/NZS3500.
- SURFACE IDENTIFICATION MARKERS ARE TO BE PROVIDED TO P.T.W. REQUIREMENTS.

PIPE SCHEDULE

SIZE	TYPE	CLASS	LENGTH
DN100	m.P.V.C.	PN16	395

RAR (Infrastructure) Pty Ltd
 On Behalf Of
Pitt Town + Water
 Date: 05 / 09 / 2014
FOR CONSTRUCTION

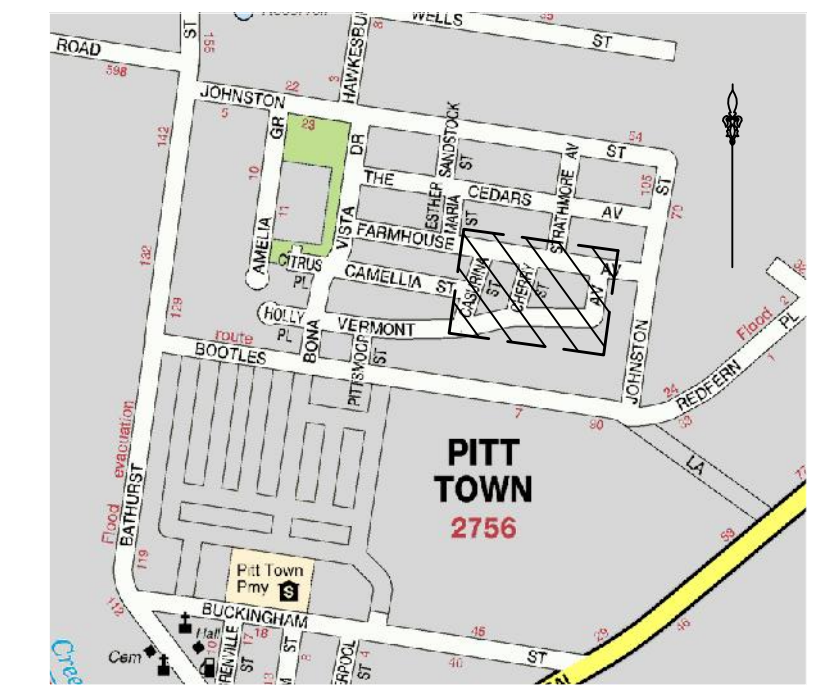

LOCALITY DIAGRAM
(NOT TO SCALE)

SERVICE	DATE	REF.

ROSE ATKINS RIMMER (Infrastructure) Pty. Ltd.
 WATER RELATED INFRASTRUCTURE DESIGN AND MANAGEMENT
RAR
 142 SUNNYHOLT ROAD, BLACKTOWN
 P.O. BOX 6745, BLACKTOWN N.S.W. 2148
 PH: (02) 9853 0200 FAX: (02) 9671 7399

CLIENT: **ipg**
 TITLE: PLAN OF PROPOSED RECYCLED WATER INFRASTRUCTURE
 BONA VISTA SUBDIVISION - STAGE 4D
 VERMONT AVENUE & OTHERS, PITT TOWN
 L.G.A. HAWKESBURY

DATE	BY	REVISION

PITT TOWN WATER REF: STAGE Pt.7P				SHEET 1 OF 1		VERSION
DRAWN	SCALE	DATUM	USER REFERENCE	JOB NO.		10/20978/BV4d
D.SHEATHER	1:500	-	67 K11			
VERIFIED	REVIEWED	APPROVED	DATE			
R.CHIVAS	S.RIMMER		3/9/2014			